
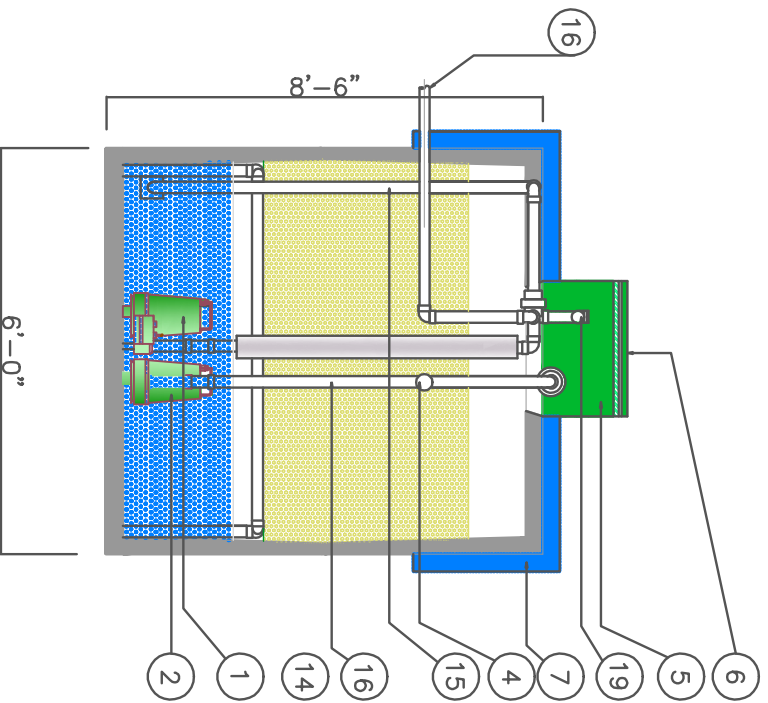


SCHEDULE OF PARTS	
NO.	DESCRIPTION
1	DISCHARGE PUMP (S)
2	RECIRCULATION PUMP (S)
3	INLET 4" DIA SCH 40 PVC
4	DISCHARGE 2" DIA SCH 40 PVC
5	POLYLOCK RISER 24" DIA
6	POLYLOCK LID W/ INSULATION
7	SUBGRADE INSULATION 2" THICK MIN
8	HIGH LEVEL ALARM FLOAT SWITCH
9	DISCHARGE PUMP ON FLOAT SWITCH
10	DISCHARGE PUMP OFF FLOAT SWITCH
11	LOW LEVEL OFF SWITCH
12	SPRAY BAR ASSEMBLY
13	SPRAY NOZZLE
14	LUNG AIR ENTRAINMENT DEVICE
15	AIR DISCHARGE LINE
16	DENITRIFICATION RETURN LINE
17	FLOAT STAND
18	UNION/ QUICK RELEASE COUPLING
19	FRESH AIR INTAKE
20	METAROCKS SUPPORT FRAME
21	ELECTRICAL JUNCTION BOX
22	SPRAY BAR SUPPORT CLAMP

ELIMINITE MODEL 320 C  
 METAROCKS VOL: 315 FT<sup>3</sup>  
 RECIRCULATION/DOSE VOLUME:  
 1500 GAL  
 CAPACITY: 2500 GPD  
 WEIGHT DRY APPROX: 31,000  
 Lb  
 DISCHARGE PUMP:  
 RECIRCULATION PUMP:  
 HYDROMATIC SPD 50

• INSTALL TANK LEVEL  
 • TANK BEDDING MUST BE FIRM AND FULLY COMPACTED AT OPTIMAL MOISTURE CONTENT TO 95% STANDARD PROCTOR. BACKFILL MUST BE FREE OF LARGE ROCKS (3"DIA), DEBRIS, FROZEN SOIL, ICE OR TRASH. CONTACT ENGINEER IF GROUND WATER INTRUSION INTO TANK EXCAVATION IS ANTICIPATED TO OCCUR AT ANY TIME OF THE YEAR.

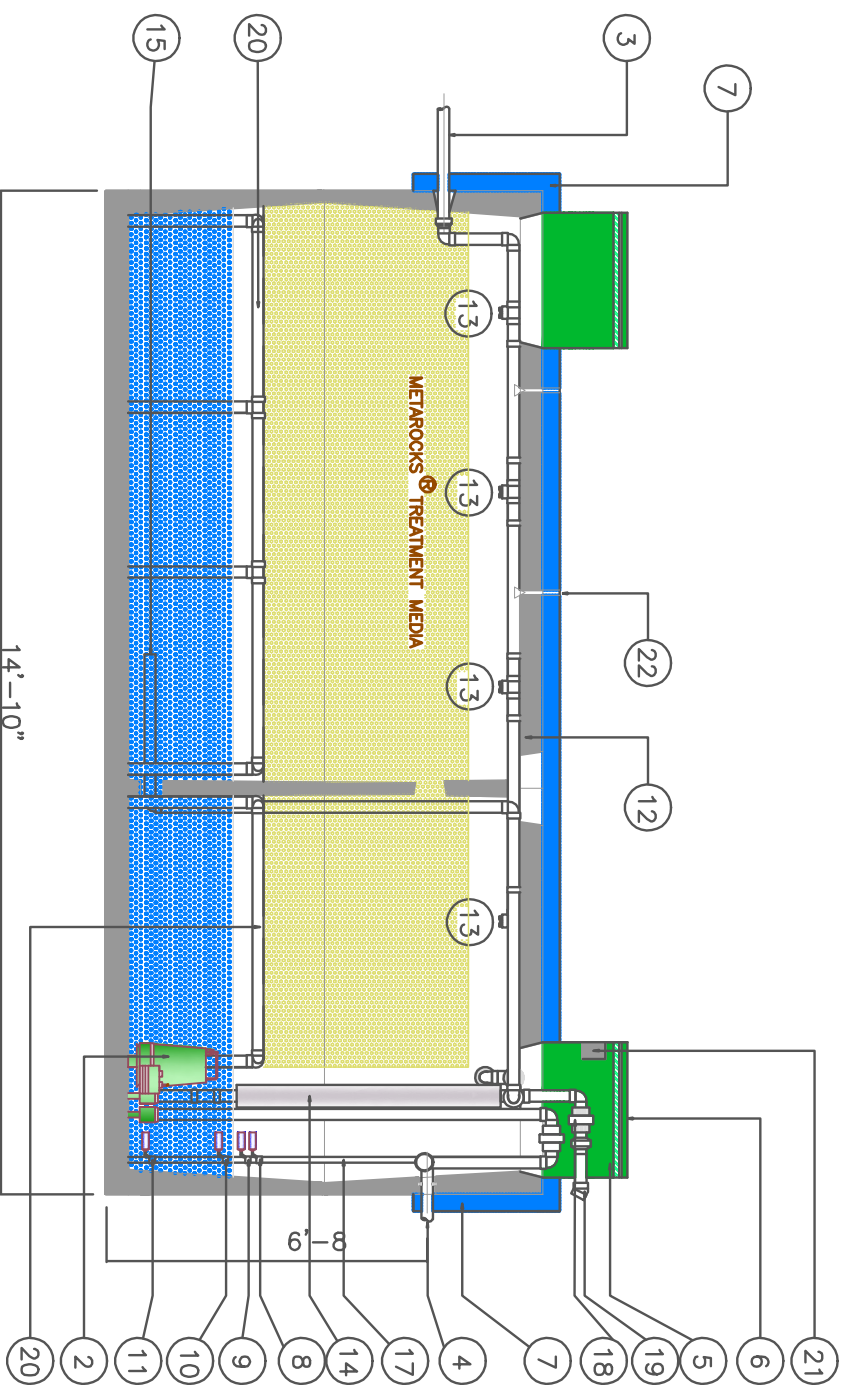

Eliminite  
 Biological Nutrient  
 Removal System  
 Model 220 C  
 Septic Tank

SCALE: 3/8" = 1'

PAGE NUMBER:

PROJECT/OWNER:

PREPARED BY:

**Eliminite Inc.**  
 SCIENTISTS • ENGINEERS • INVENTORS  
 314 ANDREA DRIVE • SUITE B • BELGRADE • MONTANA 59714 • 888-406-2289 • FAX 406-388-7549

JOB:  
 DRAWN BY: A. Westbrook

COPYRIGHT 2008 ELIMINITE, INC. ALL RIGHTS RESERVED. PRINTED IN THE UNITED STATES OF AMERICA. NO PART OF THIS DOCUMENT IS TO BE REPRODUCED, STORED IN A RETRIEVAL SYSTEM OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC, MECHANICAL, PHOTOCOPYING, RECORDING OR OTHERWISE WITHOUT THE PRIOR WRITTEN PERMISSION OF ELIMINITE, INC.



Smart • Simple • Reliable